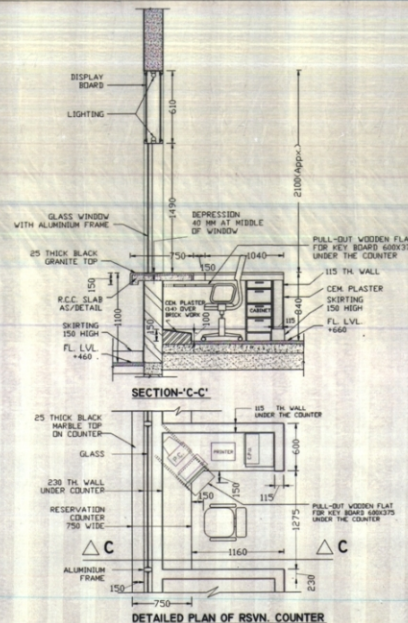




NOTES:-

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. MAX. PRESSURE ON FOUNDATIONS IS 1 / 250 K.
3. IN CASE SOL AT SITE IS NOT SAFE FOR THE ASSUMED SOIL PRESSURE THE FOUNDATIONS MAY BE SUITABLY ALTERED BY THE D.E.N. CONCERNED UNDER ADVICE TO HEAD QUARTERS OFFICE.
4. ALL BRICK WORK SHALL BE IN CEMENT MORTAR 1:6 EXCEPT 1:4 THICK BRICK WALL WHICH WILL BE CONSTRUCTED IN CEM. MORTAR 1:4.
5. PLINTH LEVEL IS KEPT 440 ABOVE NATURAL GROUND LEVEL.
6. HOWER THE SAME MAY BE INCREASED TO SUIT CONDITIONS.
7. R.C.C. BEAMS TO BE PROVIDED AT LINTEL LEVEL AND PLINTH LEVEL IN ALL WALLS AS PER DETAIL WITH TWO COATS OF HOT BITUMEN APPLIED OVER PLINTH BEAM.
8. TO TOP LEVEL OF PLINTH BEAM SHALL BE SAME AS FINISHED FLOOR LEVEL EXCEPT AT DOOR OPENINGS WHERE IT SHALL BE KEPT BELOW THE FLOOR FINISH.
9. BOTTOM LVL. OF LINTEL BEAM SHALL BE KEPT AS PER ELEVATION.
10. BATH W.C. AND TOILET FLOORS MUST BE SUNK BY 10/20 TO PREVENT FLOW OF WATER OUT SIDE.
11. VITRIFIED PORCELAIN TILES 140 THICK KOTA STONE FLOORING TO BE PROVIDED IN THE MAIN HALL, CERAMIC TILES FLOORING TO BE PROVIDED INSIDE THE BOOKING HALL, CRIS OFFICE & SPACE FOR EXTRA COUNTERS WITH 12 THICK 650 HIGH KOTA STONE / VITRIFIED-PORCELAIN / CERAMIC TILES SKIRTING AND WITH 200 HIGH GLAZED TILES 600 IN W.C. AND BATH. CHECKERED TILES FLOORING TO BE PROVIDED AS SHOWN IN PLAN AS PER R.E.L. BOARD'S LETTER NO. 96/LH/85/13 DATED: 13.7.96.
12. INTERNAL TREATMENT OF THE BUILDING SHALL BE IN CEMENT PLASTER (1:4) & COLOUR WASHES. THE WALLS SHOULD BE MADE SMOOTH WITH PUTTY/PLASTER OF PARIS BEFORE APPLICATION OF WASHABLE OIL BOARDS DISTEMPER.
13. EXTERNAL TREATMENT OF THE BUILDING SHALL BE PARTLY RULED POINTING / STONE CLADDING / CEMENT PLASTERED (1:4) WITH CEMENT COLOUR PAINT OF APPROVED QUALITY AS PER ELEVATION.
14. ALL EXTERNAL WINDOWS TO BE PROVIDED WITH GRILLS EXCEPT W.C. BATH STOLETS WINDOWS WHERE 16" Ø BARS TO BE PROVIDED.
15. ALL WINDOWS OF W.C. BATH/TOILETS SHALL HAVE FROSTED GLASS.
16. DIRECT WATER SUPPLY FOR WATER COOLER & TOILETS TO BE PROVIDED.
17. TOILETS TO BE CONNECTED TO SEWERAGE SYSTEM.
18. SLOPE OF 1:10 TO BE PROVIDED ON TERRACE IN THE DIRECTION OF D.R.W.P. FOR DRAINAGE OF RAIN WATER.

THIS DRAWING SHALL BE USED FOR ALL NEW CONSTRUCTIONS


PLINTH AREA = 286.67 SQ. M.
PORCH AREA = 20.45 SQ.M.

DETAILED PLAN OF RSVN. COUNTER

TYPICAL LINTEL BAND FOR 230 THICK WALLS
SCALE: 1:10TYPICAL LINTEL BAND FOR 115 THICK WALLS
SCALE: 1:10

DRAWING REFERENCES

S.N.	DESCRIPTION OF PLAN	PLAN NO.	SHEET NO.
1	FOR R.C.C. DETAILS	N.R. TYPE	3 & 4

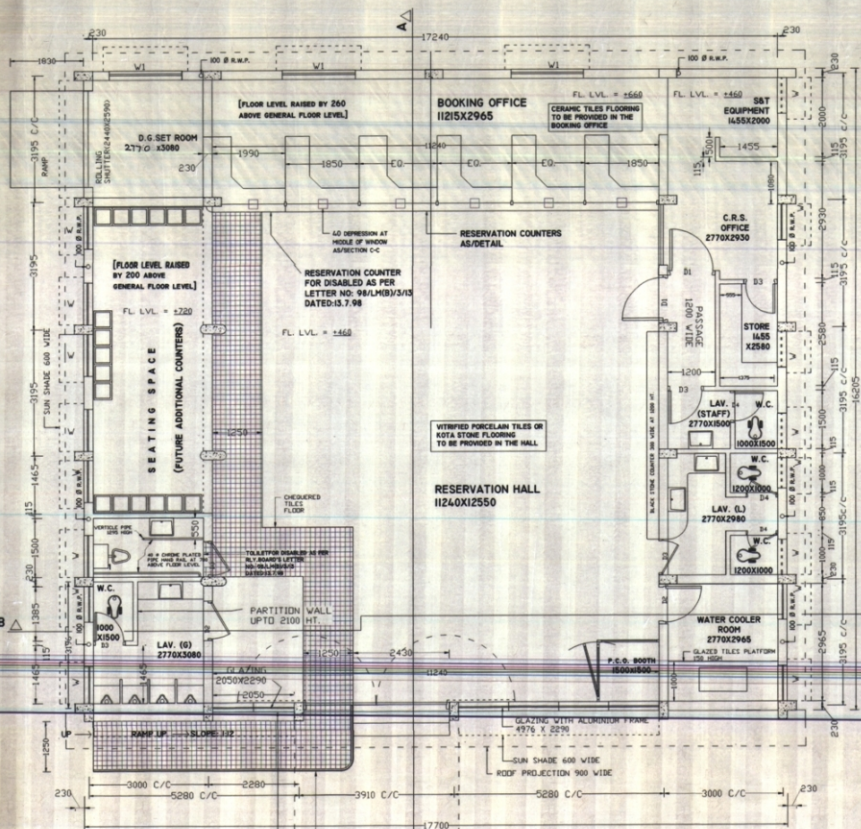

PLAN

DORS/WINDOWS SCHEDULE

S.N.	TYPE	SIZE	DESCRIPTION
1	D1	1200 X 2135	WOODEN FLUSH DOOR
2	D2	1000 X 2135	WOODEN FLUSH DOOR
3	D3	900 X 2130	WOODEN FLUSH DOOR
4	D4	750 X 2000	WOODEN FLUSH DOOR
5	W	900 X 1840	GLAZED WINDOW WITH FAN-LIGHT
6	V	900 X 455	GLAZED VENTILATOR
7	W1	1830 X 1840	GLAZED WINDOW WITH FAN-LIGHT

Signature: [Signature]
Date: [Date]
N.R.H.Q.E. PLAN NO. HQ 110/05/2003

NORTHERN RAILWAY
STANDARD PLAN OF
COMPUTERISED
RESERVATION CENTRE
(FOR 6 COUNTERS)

SCALE: 1/50, 1/25, 1/10
N.R.H.Q.E. PLAN NO. HQ 110/05/2003
SHEET NO. 1

S.NO.	DESCRIPTION	REVISIONS
1	REVISIONS	