N.R. TYPE P-35/R-I

DESIGN FOR WATER COOLER ROOMS ON RAILWAY STATIONS.

N. R. H. Q. E. PLAN Nº H.Q.|2|77/R1

CANCELS: TYPE P-23.

SCALE:- 1:50

NOTES:-

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. INTERNAL TREATMENT OF THE ROOM SHALL BE CEMENT PLASTERED AND WHITE WASHED.
3. EXTERNAL TREATMENT SHALL BE AS SHOWN IN ELEVATION OR AS DECIDED BY THE D.E.N. CONCERNED.
4. 230 THICK BRICK WORK TO BE IN CEMENT MORTAR 1:6 AND 115 THICK BRICK WORK TO BE IN CEMENT MORTAR 1:4.
5. LOCATION OF WATER COOLER ROOM TO BE DECIDED JOINTLY BY THE D.E.E., D.E.N. AND D.C.S.
6. DESIGN (1) :- FOR 2 SINGLE PHASE WATER COOLER (STORAGE CAPACITY 180 LITRES EACH)
7. DESIGN (2) :- FOR 2 SINGLE PHASE WATER COOLER (STORAGE CAPACITY 180 LITRES EACH)
8. THIS PLAN IS MADE FOR SINGLE PHASE WATER COOLERS. IF 3 PHASE BULK WATER COOLER/CHILLER IS TO BE PROVIDED, THE SPACE REQUIREMENT IS DIFFERENT AND THEREFORE, THIS PLAN IS NOT TO BE ADOPTED.


DIVISION
(R) R.C.C. PARAPET OVER THE ROOF OMITTED.


Dy. CE/E/IPAO
C.E.IPAO

TRUE COPY

S. D. O. E.

A.E.N./H.Q.



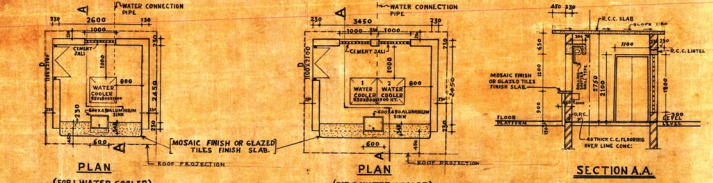

Sd/- 22-11-77	Sd/- 22-11-77	Sd/- 5-1-77	Sd/- 5-1-77	
A.E.N./H.Q.	S.E.N./B. SPL	Dy.C.E./REP.	FOR C.E./ELEC.	

DRAWN: B.CHANDRA
CHECKED: S.S. MANIPAL
C.D.A. 3RD/DARSHAL
TRACED BY:
COMPARED: